


DISCONNECT SWITCH, BRANCH CIRCUIT PROTECTION AND/OR OVERLOAD RELAY TO BE PROVIDED BY INSTALLER (SEE MANUAL FOR SIZING)

CUSTOMER CONNECTIONS (SEE NOTE 1) SEE ACCEPTABLE VOLTAGES

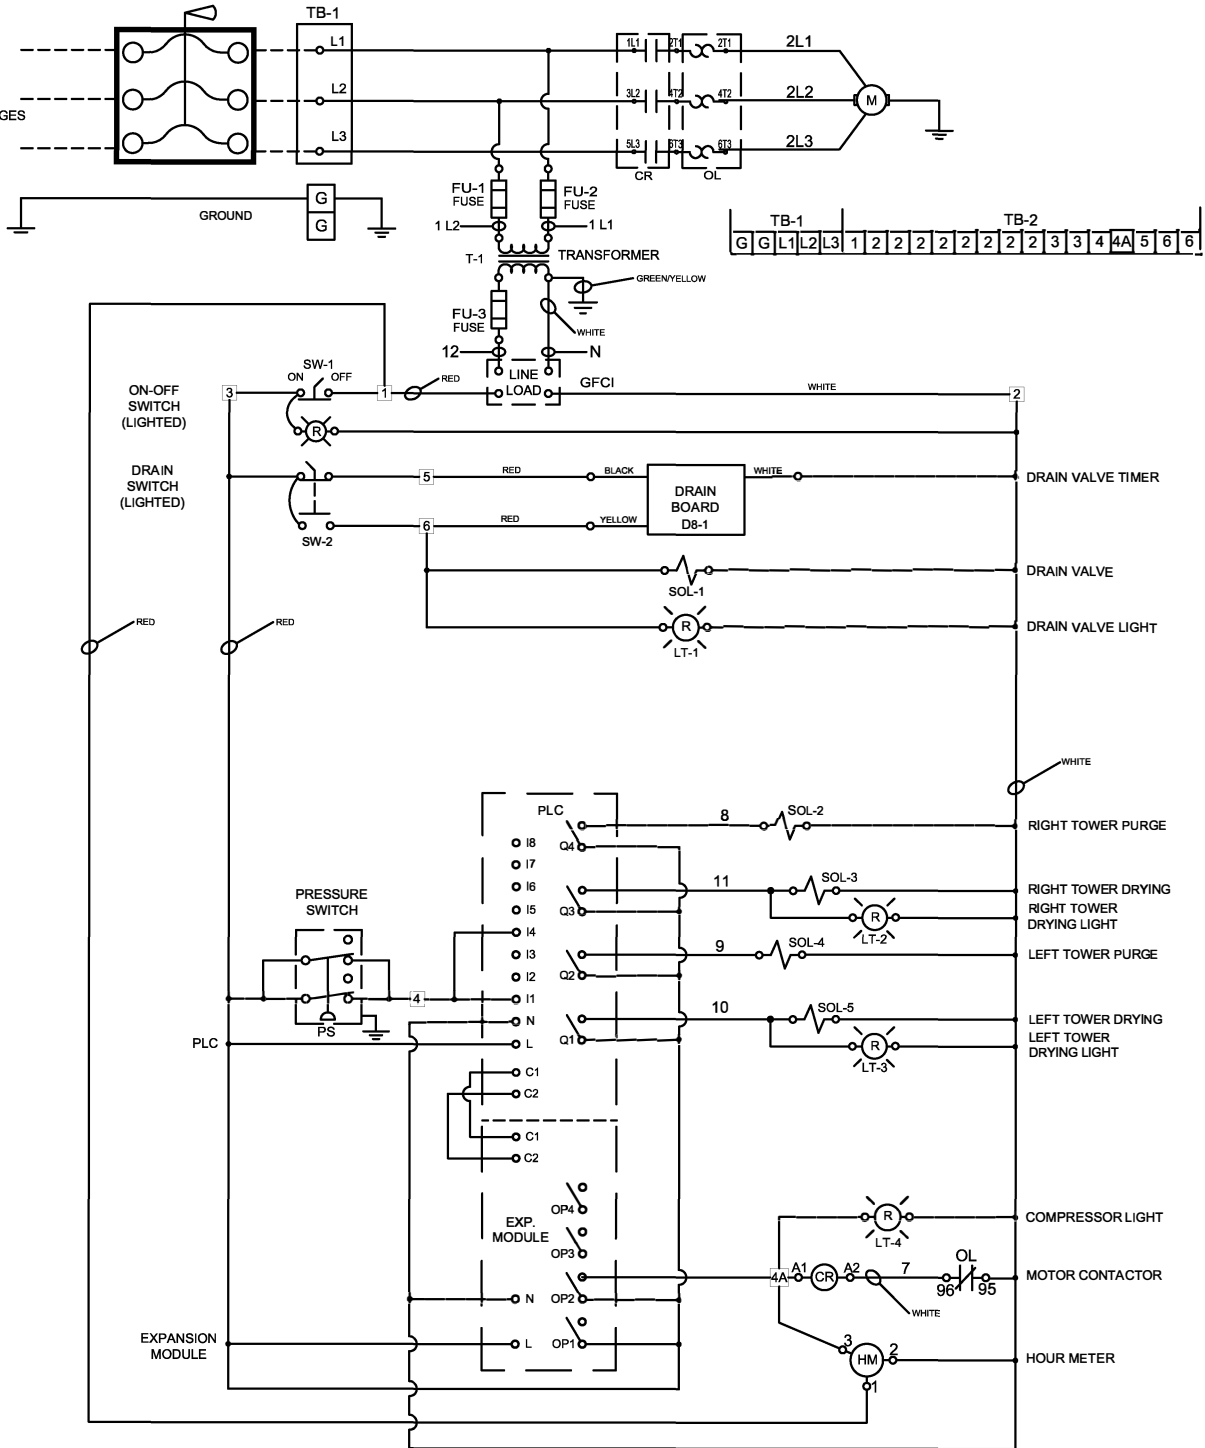

- NOTES:
- 1) INPUT VOLTAGE IS CONNECTED TO L1, L2 AND L3 CONNECTIONS ON THE POWER TERMINAL BLOCK.
 - 2) TRANSFORMER CONNECTIONS ARE DETERMINED BY SUPPLY VOLTAGE.
 - 3) ACCEPTABLE VOLTAGES:
 DAP500B, DAP1000B AND DAP2000B: 460V/230V/208V/3PH/60HZ
 DAP500B-5, DAP1000B-5 AND DAP2000B-5: 575V/3PH/60HZ
 DAP500B-50: 190V/200V/208V/220V/380V/400V/415V/3PH/50HZ
 DAP1000B-50 AND DAP2000B-50: 190V/200V/208V/220V/380V/400V/415V/440V/3PH/50HZ
 - 4) MOTOR TO BE UNDERWRITERS LABORATORIES RECOGNIZED OR APPROVED.

LEGEND:
 FACTORY WIRING _____
 FIELD WIRING - - - - -
 OPTIONAL COMPONENTS



THIS DRAWING AND ALL OF ITS CONTENTS ARE THE SOLE PROPERTY OF GENERAL AIR PRODUCTS, INC. DETAILS MAY CHANGE WITHOUT NOTICE. THE CONTENTS OF THIS DRAWING, MAY NOT BE REPRODUCED OR INCORPORATED IN WHOLE OR IN PART IN ANY EQUIPMENT, NOR THE MANUFACTURE OF ANY PARTS, WITHOUT WRITTEN CONSENT OF GENERAL AIR PRODUCTS, INCORPORATED.

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES TOLERANCES ARE:
 FRACTIONS DECIMALS ANGLES
 ± 1/4 .XX ± .13 ± 1/2

APPROVALS	DATE	TITLE
DRAWN GWS	12/09/15	WIRING DIAGRAM DAP WITH PLC OPTION 3 PHASE
CHECKED RM	12/09/15	
SCALE NTS	SIZE	
SHEET 1/1	A	
DWG NO.		E-215404
REV		5